

2000 I-30 E
Greenville, TX 75402

Thursday, February 26, 2026

County: Hopkins County

Farmers Electric Cooperative Member: ADRIE VANDERJAGT
Service Order Number: 2025062756

Greetings:

Farmers Electric Cooperative, Inc. is requesting permission to construct electrical power distribution facilities which will cross **CR 2332/BETHEL RD**

Site location map/construction sketches are attached. The construction sketch details the proposed work. The proposed electrical service will be constructed:

- ☒ Overhead - All road crossings will have a minimum vertical clearance of 22 feet.
- ☐ Underground - All underground bore crossings are PVC encased 4' of coverage from the lowest point of the Right of Way.

If you have any questions, please contact me at any time.

Sincerely,

Shaya Smith
ssmith@farmerselectric.coop
Engineering Coordinator

Enclosures

County Approval Section:


Approved: J Denied: _____

Authorized Signature: [Signature]

Date: 3-10-26



2000 I-30 E
Greenville, TX 75402

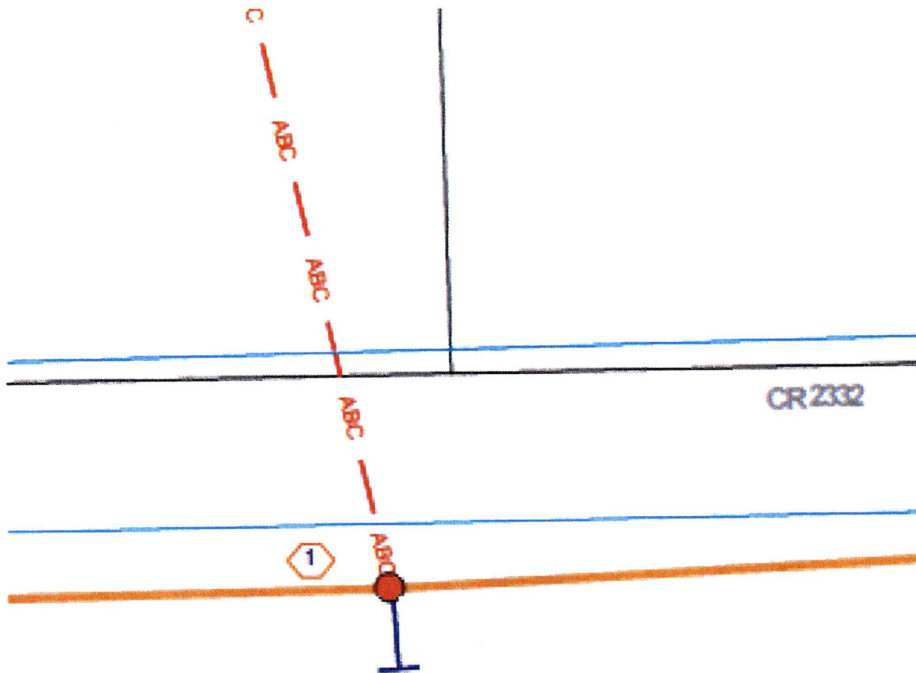

X: -95.4463 Y:
33.0637



2000 I-30 E
Greenville, TX 75402

Friday, February 27, 2026

County: Hopkins County

Farmers Electric Cooperative Member: EDWIN KNOLES
Service Order Number: 2025085614

Greetings:

Farmers Electric Cooperative, Inc. is requesting permission to construct electrical power distribution facilities which will cross County Road 2415

Site location map/construction sketches are attached. The construction sketch details the proposed work. The proposed electrical service will be constructed:

- ☒ Overhead - All road crossings will have a minimum vertical clearance of 22 feet.
☐ Underground - All underground bore crossings are PVC encased 4' of coverage from the lowest point of the Right of Way.

If you have any questions, please contact me at any time.

Sincerely,

Linda Graham
lgraham@farmerselectric.coop
Engineering Coordinator

Enclosures


County Approval Section:

Approved: J

Denied: _____

Authorized Signature:

Date: 3/0-26

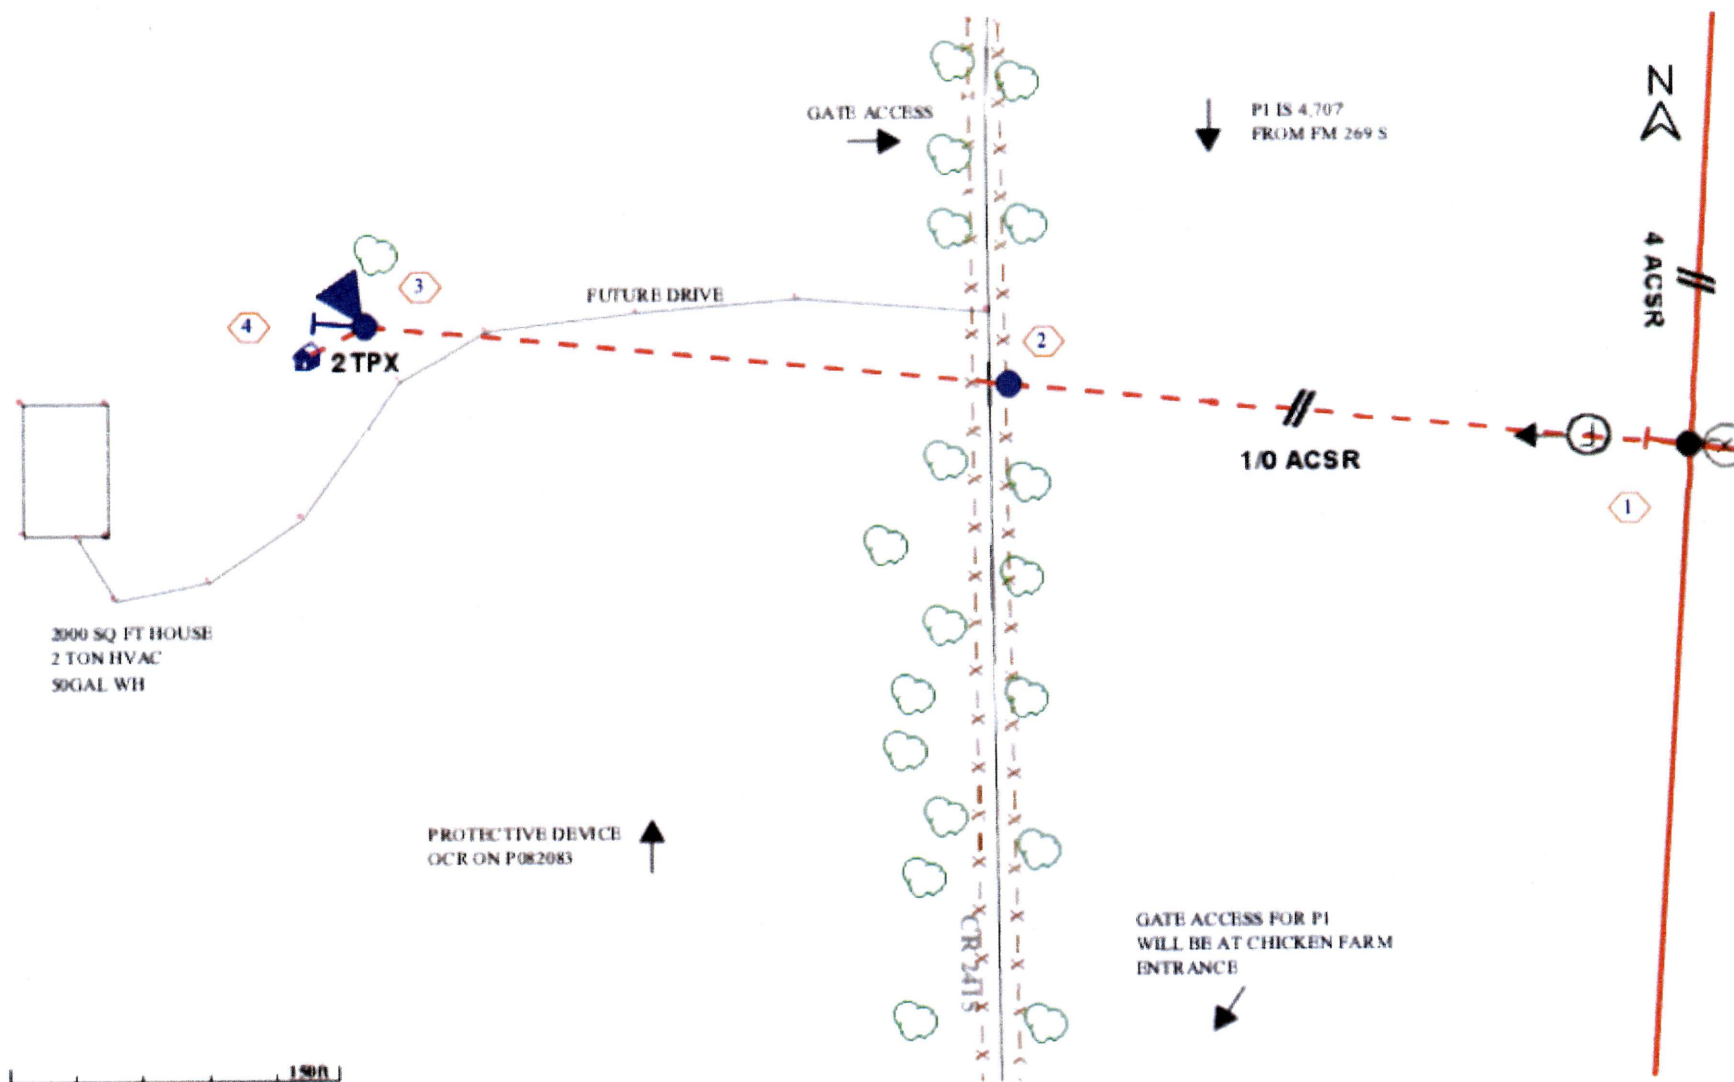



2000 I-30 E
Greenville, TX 75402

Thursday, March 5, 2026

County: Hopkins County

Farmers Electric Cooperative Member: BARRY LEHR
Service Order Number: 2026025062

Greetings:

Farmers Electric Cooperative, Inc. is requesting permission to construct electrical power distribution facilities which will cross County Road 4764 AT NEW POLE WHICH WILL BE INSTALLED BETWEEN POLES 081962 AND 081970. IT WILL BE 163' S OF P081962.

Site location map/construction sketches are attached. The construction sketch details the proposed work. The proposed electrical service will be constructed:

- ☒ Overhead - All road crossings will have a minimum vertical clearance of 22 feet.
☐ Underground - All underground bore crossings are PVC encased 4' of coverage from the lowest point of the Right of Way.

If you have any questions, please contact me at any time.

Sincerely,

Psalm Harper
pharper@farmerselectric.coop
Engineering Coordinator


Enclosures

County Approval Section:

Approved: _____ Denied: _____

Authorized Signature: _____

Date: 3-6-26

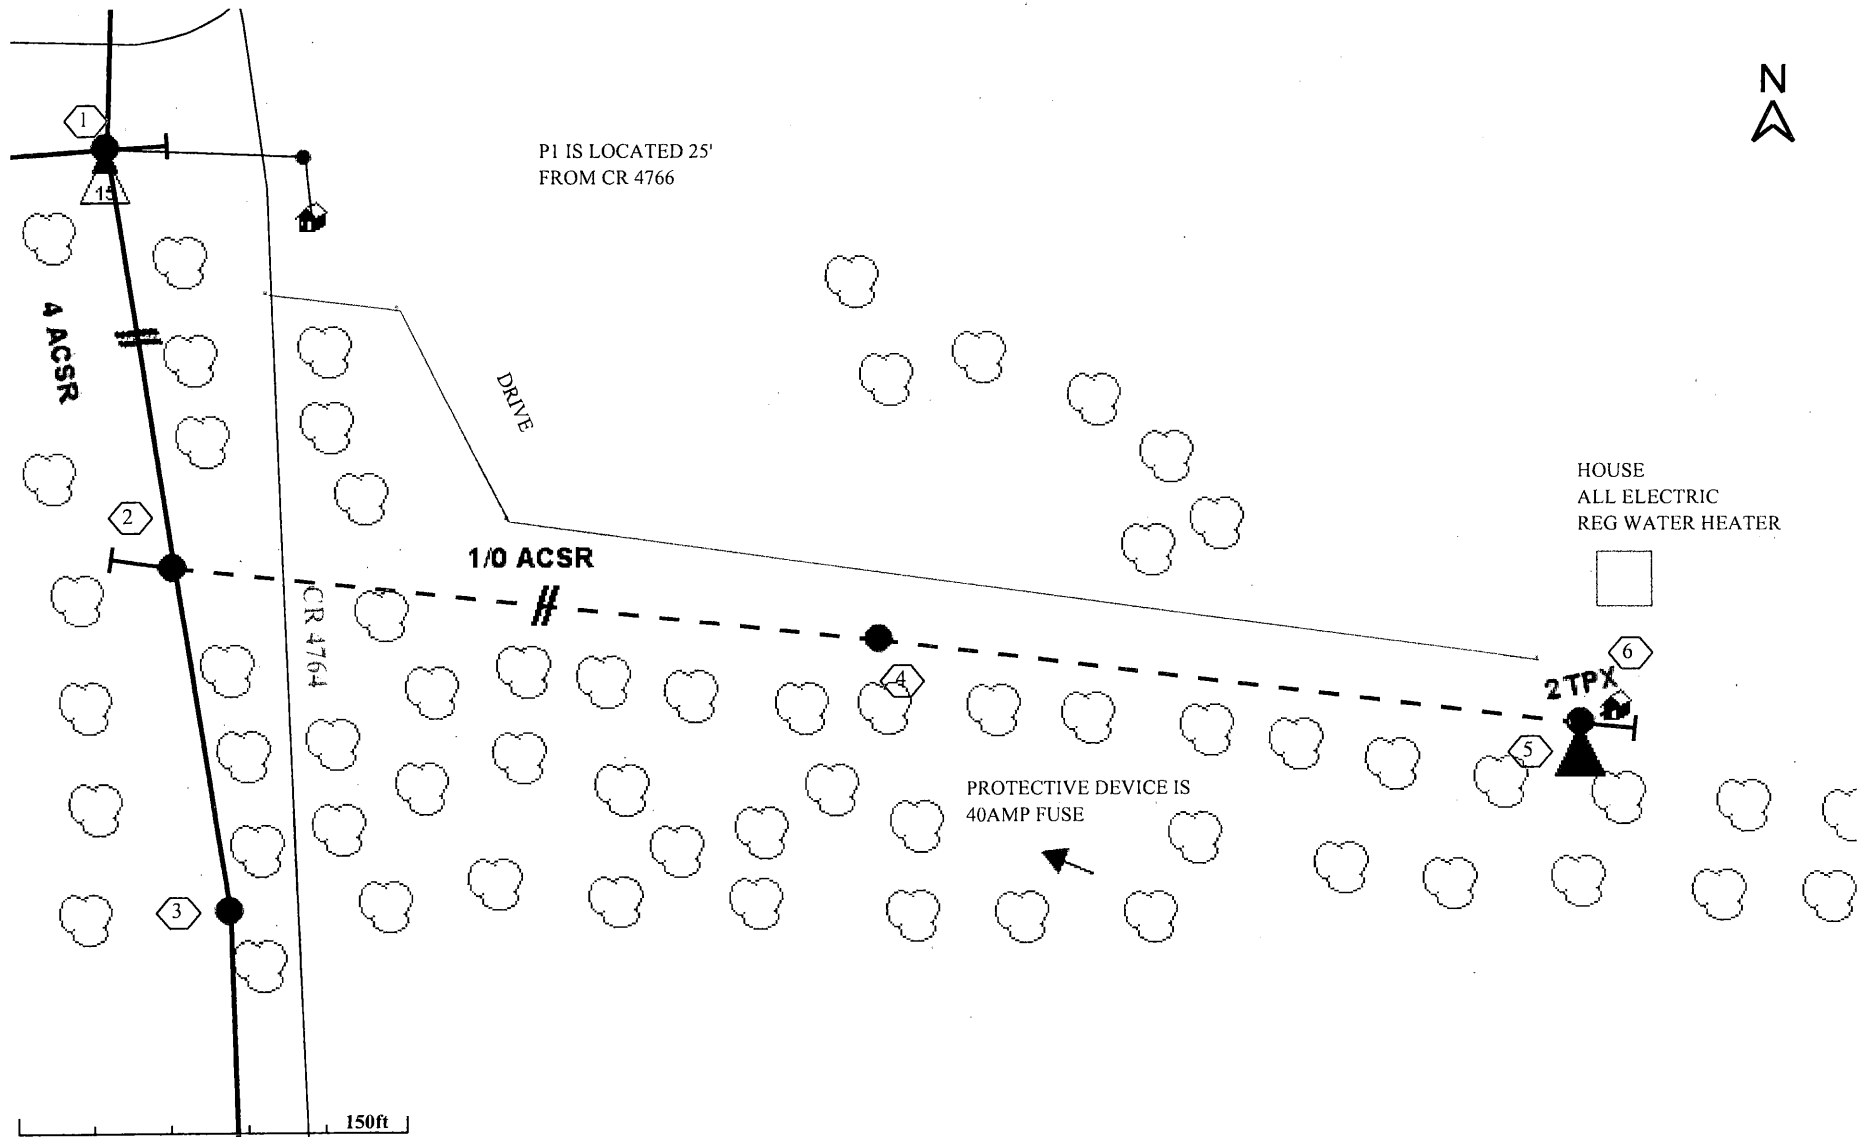

		W.O. NO: 2026025062.11 County: HOPKINS PJN: JT 2024021922 LEHR		City: Subdivision: Source and Feeder: 0603 911 Address: 1180 COUNTY ROAD 4764		Member: BARRY LEHR Grid No: 0623390050012 School:		Staked By: jthomas - 02/07/2024 Restaked: Crew: Completed By:	
OH MP Not Ready 02/07/2024									7.2KV
1 Source: none Phase: C PHASE Span: 0 Comments: POLE 081962 Existing (1) 40-3 (C) Comment: 2005 Existing (0) 4 ACSR (C) Existing (1) DVG19-15 (C) Existing (1) E1-2 (C) Existing (1) E3-10 (C) Existing (1) F1-2SH (C) Existing (1) K14 (C) Existing (1) VA1-1 (C) Existing (1) VA5-1 (C) Existing (1) VM2-11 (C) Existing (1) VM5-9 PMB (C)	2 Source: 1 Phase: C PHASE Span: 163 Comments: NEW POLE Existing (163) 4 ACSR (C) New (1) 40-4 (H) New (1) E1-3 (H) Comment: 30' GL New (1) E3-10 (H) New (1) F1-3SH (H) New (1) POLESET (C) New (1) VA1 (H) New (1) VA5-1E (H) New (1) VM2-12 (H)	3 Source: 2 Phase: C PHASE Span: 113 Comments: POLE 081970 Existing (1) 40-3 (C) Comment: 2005 Existing (113) 4 ACSR (C) Existing (1) VA1 (C) Existing (1) VM2-12 (C)	4 Source: 2 Phase: C PHASE Span: 273 Comments: NEW POLE New (546) 1/0 ACSR (C) New (1) 40-4 (C) New (1) POLESET (C) New (1) VA1-1 (C) New (1) VM2-12 (C)	5 Source: 4 Phase: C PHASE Span: 273 Comments: NEW POLE New (546) 1/0 ACSR (C) New (33) 1/0 ACSR SAG (C) New (1) 40-4 (C) New (1) DVG10-15 (C) New (1) E1-3 (C) Comment: 30' GL New (1) E3-10 (C) New (1) F1-3SH (C) New (1) K14 (C) New (1) POLESET (C) New (1) VA5E (C) New (1) VM2-11 (C) New (1) VM5-9 PMB (C)	6 Source: 5 Phase: C PHASE Span: 15 Comments: TEMP POLE New (1) 2S 200A 120/240V OH (C) Comment: TEMP POLE New (10) 2 TPX SAG (C) New (15) 2 TPX SERV (C) New (1) K10 (C)				

Locates: DIGTESS, NORTH HOPKINS, P1 = 33.248236 -95.599292	Misc. Remarks: FROM POLE 081970, INSTALL 1 POLE IN LINE AND BUILD NEW PRIMARY TAP TO PULL ACROSS CR 4764 AND SET (2) NEW POLES. INSTALL 15KVA XFMR AND RUN A PERM OH SERVICE TO A 200AMP OHMP. MEMBER TO CUT TREES. MEMBER TO MOVE MATERIALS OUT OF THE NEW LINE PATH. RQS CONST RLS. RQS HOPKINS CR CROSSING PERMIT. RQS 2 EASE (PROP ID R000017530)(PROP ID R000021152). XFMR AND METER ARE IN GRID 06-23390050012. R1/R1. ATC DUE. JT
---	---